
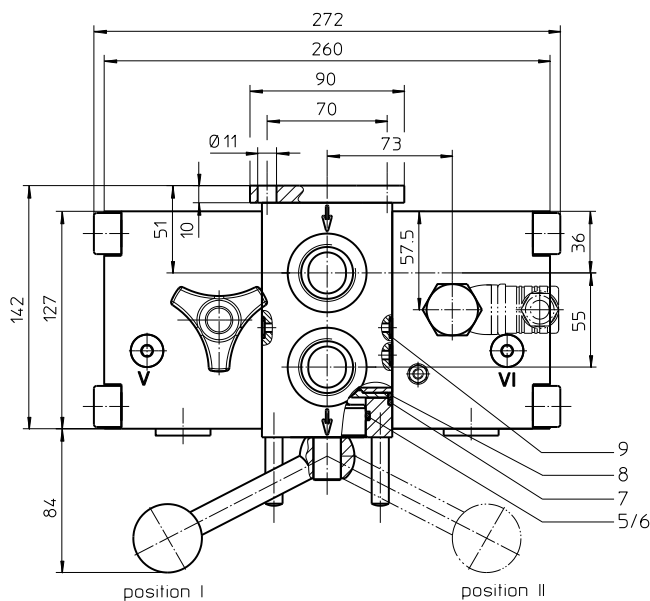


Series EHD 61-151

DN25 PN315

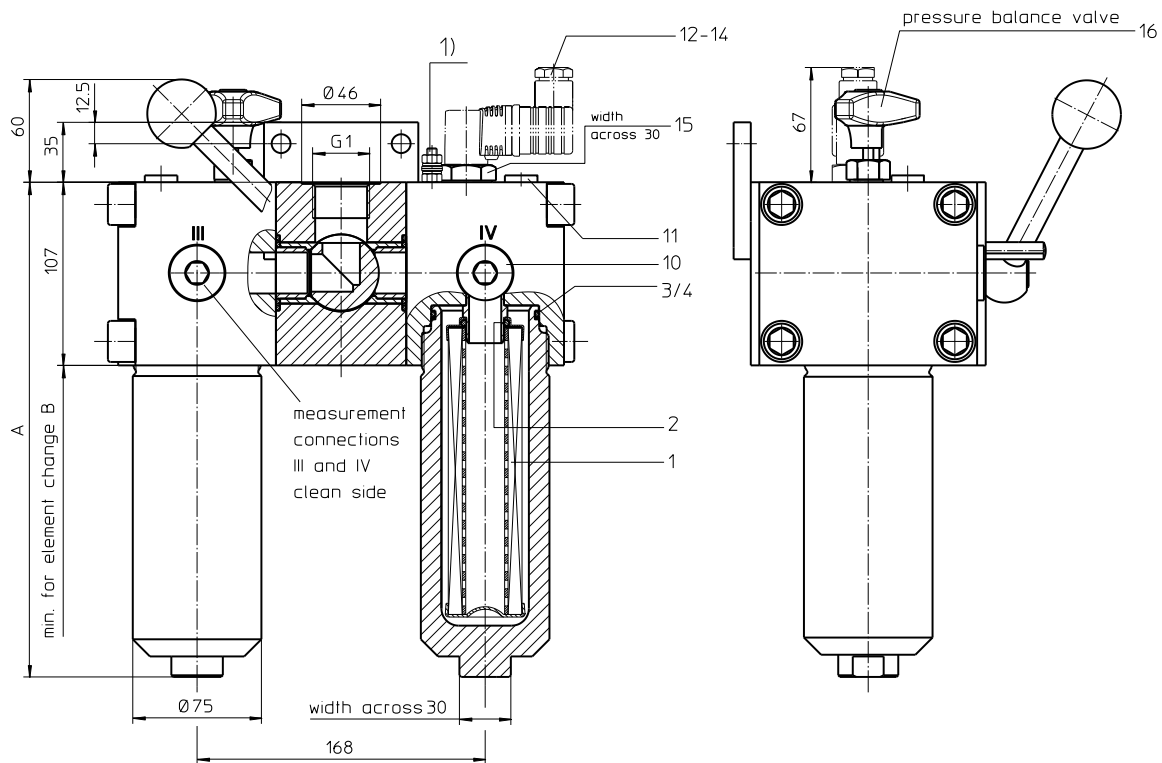

1) Connection for the potential equalization, only for application in the explosive area.

Connections V and VI to be used for pressure relief and air bleeding respective filter side.

Dimensions:

| type | EHD 61 | EHD 91 | EHD 151 |
|-------------|-----------|----------|----------|
| connection | G 1 | | |
| A | 224 | 289 | 399 |
| B | 210 | 340 | 450 |
| weight kg | 31 | 34 | 38 |
| volume tank | 2x 0,25 l | 2x 0,4 l | 2x 0,6 l |

Position I: left filter side in operation
Position II: right filter side in operation

Dimensions: mm

Designs and performance values are subject to change.

EDV 10/19

Pressure Filter, change over Series EHD 61-151 DN25 PN315

Description:

Stainless steel-pressure filters change over series EHD 61-151 are suitable for operating pressure up to 315 bar. The pressure peaks are absorbed by a sufficient margin of safety.

Duplex filters can be serviced without interruption of operation. The upper part has a three-way-change-over valve which allows to change-over the flow from the dirty filter-side to the clean filter-side without interrupting the operation. The change-over procedure does not lead to a cross sectional contraction. Prior to the change-over procedure a built-in pressure balance valve equalizes the housing pressure. After change-over the pressure balance valve is to be closed again. The closed filter-side has to be air-bled by vent V respectively by vent VI. Then change filter element. After screw in the filter bowl the pressure balance has to be opened shortly and the just serviced filter-side has to be air-bled. Filter elements are available down to a filter fineness of $5 \mu\text{m}_{(C)}$.

Eaton filter elements are known for high intrinsic stability and an excellent filtration capability, a high dirt-retaining capacity and a long service life.

Eaton filter elements are available with a pressure difference resistance up to Δp 160 bar and a rupture strength up to Δp 250 bar.

The internal valves are integrated into the centering pivot for the filter element.

After reaching the opening pressure the by-pass valve causes that an unfiltered partial flow passes the filter. The reversing valve provides another level of protection for the filter element. The reverse flow will not be filtered.

Eaton filter are suitable for all petroleum based fluids, HW-emulsions, most synthetic hydraulic fluids and lubrication oils.

Type index:

Complete filter: (ordering example)

EHD. 91. 10VG. HR. E. P. VA. G. 5. VA. - . - . AE

| | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|----|----|----|----|
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 |
|---|---|---|---|---|---|---|---|---|----|----|----|----|

- | | |
|----|--|
| 1 | series: EHD = Stainless steel-pressure filter change over |
| 2 | nominal size: 61, 91, 151 |
| 3 | filter material: 80G, 40G, 25G stainless steel wire mesh 25VG, 16VG, 10VG, 6VG, 3VG microglass |
| 4 | filter element collapse rating: 30 = Δp 30 bar HR = Δp 160 bar (rupture strength Δp 250 bar) |
| 5 | filter element design: E = single-end open |
| 6 | sealing material: P = Nitrile (NBR) V = Viton (FPM) |
| 7 | filter element specification: - = standard VA = stainless steel |
| 8 | process connection: G = thread connection according to ISO 228 |
| 9 | process connection size: 5 = G 1 |
| 10 | filter housing specification: VA = stainless steel |
| 11 | specification pressure vessel: - = standard (PED 2014/68/EU) IS20 = ASME VIII Div.1 with ASME equivalent material, see sheet-no. 55217 (max. operating pressure 250 bar) |
| 12 | internal valve: - = without S1 = with bypass valve Δp 3,5 bar S2 = with bypass valve Δp 7,0 bar R = reversing valve, $Q \leq 70,06$ l/min |
| 13 | clogging indicator or clogging sensor: - = without AOR = visual, see sheet-no. 1606 AOC = visual, see sheet-no. 1606 AE = visual-electric, see sheet-no. 1615 VS5 = electronic, see sheet-no. 1619 |

To add an indicator/sensor to your filter, use the corresponding indicator data sheet to find the indicator details and add them to the filter assembly model code.

Filter element: (ordering example)

01E. 90. 10VG. HR. E. P. VA

| | | | | | | |
|---|---|---|---|---|---|---|
| 1 | 2 | 3 | 4 | 5 | 6 | 7 |
|---|---|---|---|---|---|---|

- | | |
|---|--|
| 1 | series: 01E = filter element according to company standard |
| 2 | nominal size: 60, 90, 150 |
| 3 | - 7 see type index-complete filter |

Accessories:

- gauge port- and bleeder connections, see sheet-no. 1650

For more information:

WEB: FLTR.com.au PHONE: (+61) 1300 62 4020 EMAIL: info@FLTR.com.au SKYPE: Purple.Engineering



Technical data:

| | |
|---|--|
| operating temperature: | -10°C to +100°C |
| operating medium: | mineral oil, other media on request |
| max. operating pressure: | 315 bar |
| test pressure: | 450 bar |
| max. operating pressure at IS20: | 250 bar |
| test pressure at IS20: | 325 bar |
| process connection: | thread connection according to ISO 228 |
| housing material: | EN10088-1.4571 (320 S 18, 320 S 31 according to B.S.) |
| sealing material: | Nitrile (NBR) or Viton (FPM), other materials on request |
| installation position: | vertical |
| measuring- and bleeder connections dirt side: | G ¼ |
| measuring connections clean side: | G ¾ |

Classified under the Pressure Equipment Directive 2014/68/EU for mineral oil (fluid group 2), Article 4, Para. 3.
Classified under ATEX Directive 2014/34/EU according to specific application (see questionnaire sheet-no. 34279-4).

Pressure drop flow curves:

Filter calculation/sizing

The pressure drop of the assembly at a given flow rate Q is the sum of the housing Δp and the element Δp and is calculated as follows:

$$\Delta p_{assembly} = \Delta p_{housing} + \Delta p_{element}$$

$$\Delta p_{housing} = (\text{see } \Delta p = f(Q) - \text{characteristics})$$

$$\Delta p_{element} (mbar) = Q \left(\frac{l}{min} \right) \times \frac{MSK}{10} \left(\frac{mbar}{l/min} \right) \times v \left(\frac{mm^2}{s} \right) \times \frac{p}{0,876} \left(\frac{kg}{dm^3} \right)$$

For ease of calculation our Filter Selection tool is available online at www.eatonpowersource.com/calculators/filtration/


Material gradient coefficients (MSK) for filter elements

The material gradient coefficients in mbar/(l/min) apply to mineral oil (HLP) with a density of 0,876 kg/dm³ and a kinematic viscosity of 30 mm²/s (139 SUS). The pressure drop changes proportionally to the change in kinematic viscosity and density.

| EHD | VG | | | | | G | | |
|-----|-------|-------|-------|-------|-------|--------|--------|--------|
| | 3VG | 6VG | 10VG | 16VG | 25VG | 25G | 40G | 80G |
| 61 | 5,438 | 3,775 | 2,417 | 2,104 | 1,438 | 0,2205 | 0,1635 | 0,1526 |
| 91 | 3,271 | 2,271 | 1,454 | 1,266 | 0,865 | 0,1333 | 0,0988 | 0,0922 |
| 151 | 1,952 | 1,355 | 0,867 | 0,755 | 0,516 | 0,0796 | 0,0590 | 0,0551 |

$\Delta p = f(Q)$ – characteristics according to ISO 3968


The pressure drop characteristics apply to mineral oil (HLP) with a density of 0,876 kg/dm³. The pressure drop changes proportionally to the density.

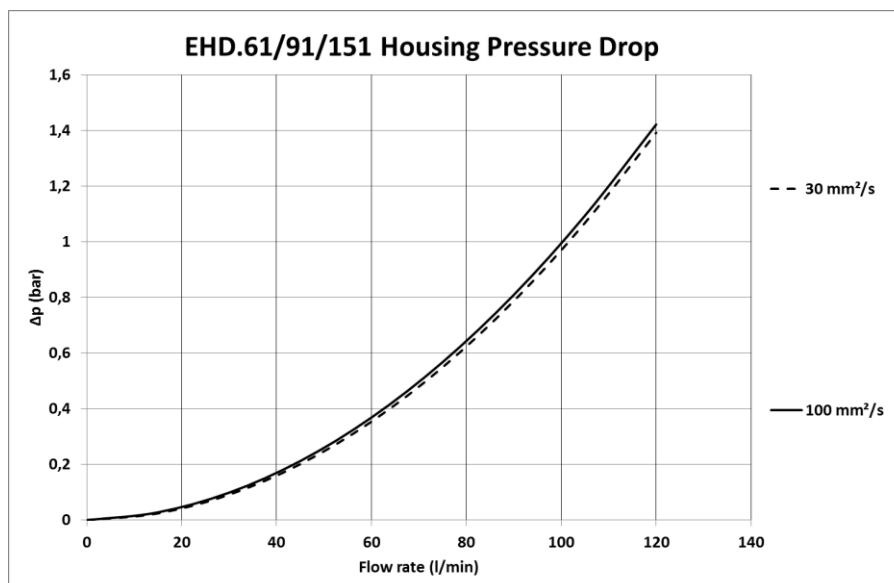

For more information:

WEB: FLTR.com.au PHONE: (+61) 1300 62 4020 EMAIL: info@FLTR.com.au SKYPE: Purple.Engineering

Symbols:

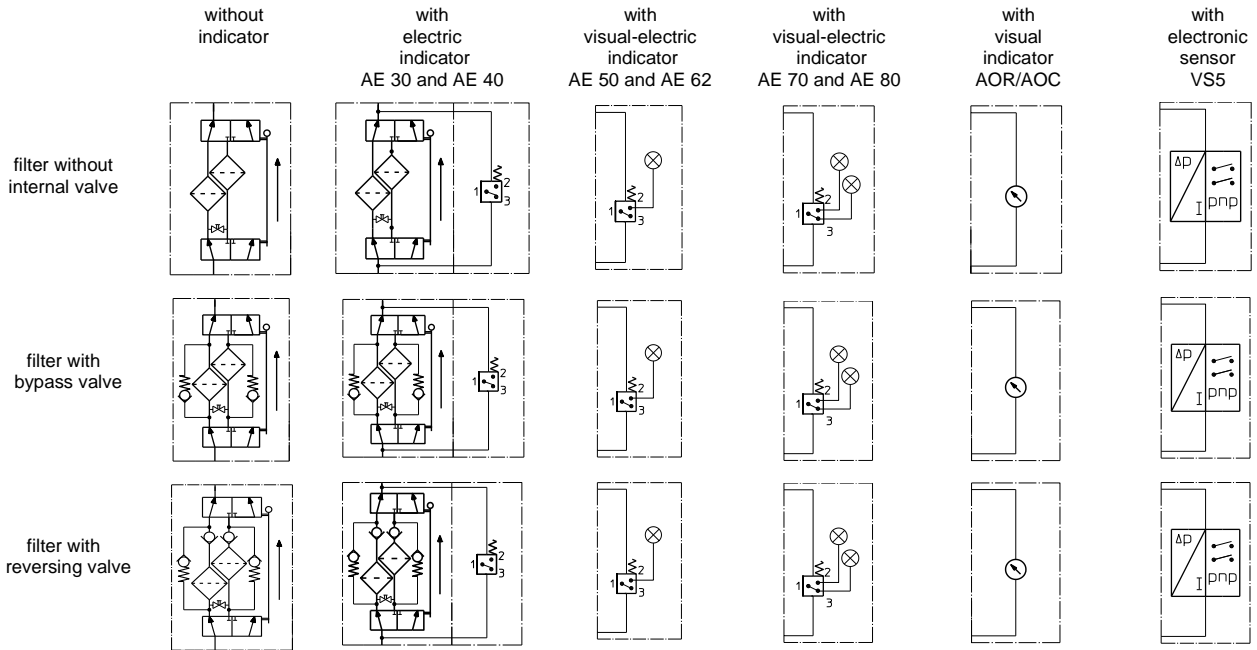

Spare parts:

| item | qty. | designation | dimension | | | article-no. | |
|------|------|-------------------------------------|----------------|-----------|------------|--------------------|--------------|
| | | | EHD 61 | EHD 91 | EHD 151 | | |
| 1 | 2 | filter element | 01E.60... | 01E.90... | 01E.150... | | |
| 2 | 2 | O-ring | 22 x 3,5 | | | 304341 (NBR) | 304392 (FPM) |
| 3 | 2 | O-ring | 56 x 3 | | | 305072 (NBR) | 305322 (FPM) |
| 4 | 2 | support ring | 63 x 2,6 x 1 | | | 312309 | |
| 5 | 3 | O-ring | 45 x 3 | | | 304991 (NBR) | 304997 (FPM) |
| 6 | 2 | support ring | 49,7 x 2,4 x 1 | | | 317709 | |
| 7 | 4 | O-ring | 38 x 3 | | | 304340 (NBR) | 317013 (FPM) |
| 8 | 4 | O-ring | 28 x 3 | | | 316778 (NBR) | 318366 (FPM) |
| 9 | 4 | O-ring | 8 x 2 | | | 310004 (NBR) | 316530 (FPM) |
| 10 | 2 | screw plug | G ¼ | | | 313815 | |
| 11 | 2 | screw plug | G ¼ | | | 306968 | |
| 12 | 1 | clogging indicator, visual | AOR or AOC | | | see sheet-no. 1606 | |
| 13 | 1 | clogging indicator, visual-electric | AE | | | see sheet-no. 1615 | |
| 14 | 1 | clogging sensor, electronic | VS5 | | | see sheet-no. 1619 | |
| 15 | 1 | screw plug | 20913-4 | | | 314442 | |
| 16 | 1 | pressure balance valve | DN10 | | | 310316 | |

item 15 execution only without clogging indicator or clogging sensor

Test methods:

Filter elements are tested according to the following ISO standards:

| | |
|-----------|---|
| ISO 2941 | Verification of collapse/burst resistance |
| ISO 2942 | Verification of fabrication integrity |
| ISO 2943 | Verification of material compatibility with fluids |
| ISO 3723 | Method for end load test |
| ISO 3724 | Verification of flow fatigue characteristics |
| ISO 3968 | Evaluation of pressure drop versus flow characteristics |
| ISO 16889 | Multi-pass method for evaluating filtration performance |

For more information:

WEB: FLTR.com.au PHONE: (+61) 1300 62 4020 EMAIL: info@FLTR.com.au SKYPE: Purple.Engineering