

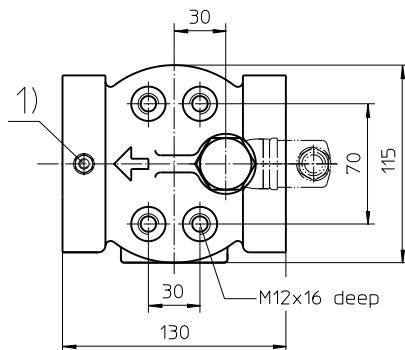


Series HP3.170-450 DN25-40 PN420

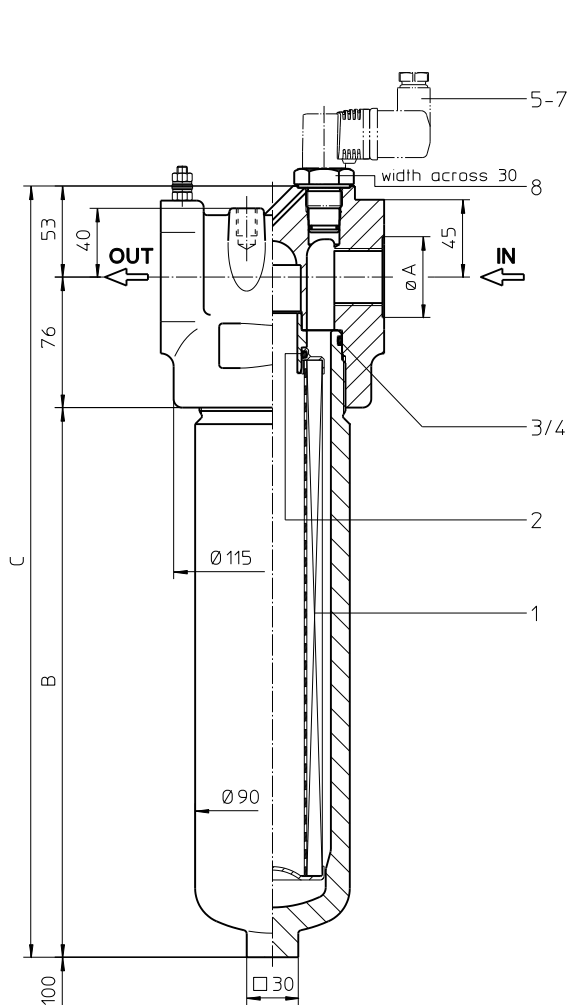


1) Connection for the potential equalization, only for application in the explosive area.

Execution flange
SAE 1 1/2"

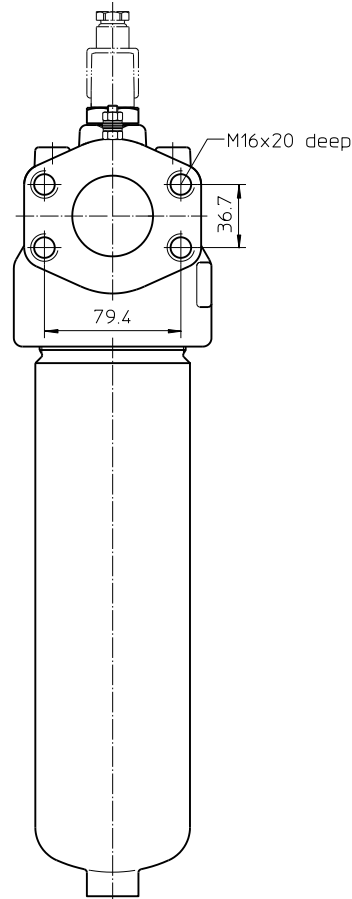

Execution thread
G1 / G1 1/4 / G 1 1/2

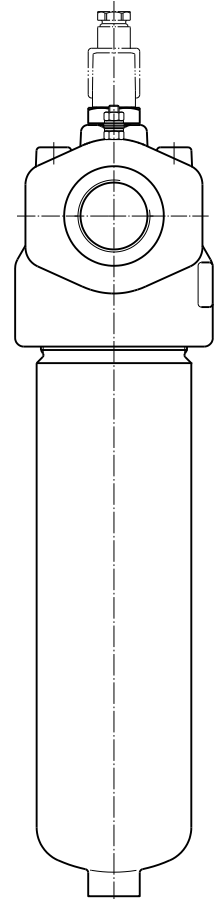

Dimensions:

| type | connection | A | B | C | weight | volume tank |
|---------|------------|------|-----|-----|--------|-------------|
| HP3.170 | G 1 | 46 | 190 | 319 | 12 kg | 0,7 l |
| | G 1 1/4 | 57 | | | | |
| | G 1 1/2 | 63,5 | | | | |
| | SAE 1 1/2" | - | | | | |
| HP3.240 | G 1 | 46 | 239 | 368 | 13 kg | 0,9 l |
| | G 1 1/4 | 57 | | | | |
| | G 1 1/2 | 63,5 | | | | |
| | SAE 1 1/2" | - | | | | |
| HP3.360 | G 1 | 46 | 320 | 449 | 14 kg | 1,2 l |
| | G 1 1/4 | 57 | | | | |
| | G 1 1/2 | 63,5 | | | | |
| | SAE 1 1/2" | - | | | | |
| HP3.450 | G 1 | 46 | 425 | 554 | 18 kg | 1,6 l |
| | G 1 1/4 | 57 | | | | |
| | G 1 1/2 | 63,5 | | | | |
| | SAE 1 1/2" | - | | | | |

Dimensions: mm

EDV 12/20

Designs and performance values are subject to change.



For more information:

WEB: FLTR.com.au PHONE: (+61) 1300 62 4020 EMAIL: info@FLTR.com.au SKYPE: Purple.Engineering

Pressure Filter

Series HP3.170-450

DN25-40 PN420

Description:

Pressure filter series HP3.170-450 have a working pressure up to 420 bar. Pressure peaks can be absorbed with a sufficient safety margin. The HP3-filter is in-line mounted.

The filter element consists of star-shaped, pleated filter material, which is supported on the inside by a perforated core tube and is bonded to the end caps with a high-quality adhesive. The flow direction is from outside to inside. Filter elements are available down to 5 $\mu\text{m}_{(c)}$. Finer filtration is available upon request.

For cleaning the stainless steel mesh element (see special leaflets 21070-4 and 39448-4) or changing the filter element, remove the filter bowl and take out the element. The mesh elements are not guaranteed to maintain 100% performance after cleaning.

Eaton filter elements are known for high intrinsic stability and an excellent filtration capability, a high dirt-retaining capacity and a long service life.

Eaton filter can be used for petroleum-based fluids, HW emulsions, water glycols, most synthetic fluids and lubrication fluids. Consult factory for specific fluid applications.

Eaton filter elements are available up to a pressure resistance of Δp 160 bar and a rupture strength of Δp 250 bar.

The internal valves are integrated into the centering pivot for the filter element. After reaching the opening pressure the by-pass valve causes that an unfiltered partial flow passes the filter.

With the reverse valve a protection of the filter element is given when having a reverse flow inside the filter. The reverse flow will not be filtered.

1. Type index:

1.1. Complete filter: (ordering example)

HP3. 170. 10VG. HR. E. P. - . G. 5. - . - . AE

| | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|----|----|----|
| 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
|---|---|---|---|---|---|---|---|---|----|----|----|

- 1 series:**
HP3 = pressure filter
- 2 nominal size:** 170, 240, 360, 450
- 3 filter-material:**
80G, 40G, 25G stainless steel wire mesh
25VG, 16VG, 10VG, 6VG, 3VG microglass
- 4 filter element collapse rating:**
30 = Δp 30 bar
HR = Δp 160 bar (rupture strength Δp 250 bar)
- 5 filter element design:**
E = single-end open
- 6 sealing material:**
P = Nitrile (NBR)
V = Viton (FPM)
- 7 filter element specification:**
- = standard
VA = stainless steel
IS06 = for HFC applications, see sheet-no. 31601
- 8 process connection:**
G = thread according to ISO 228
FS = SAE-flange connection 6000 PSI
- 9 process connection size:**
5 = G 1
6 = G 1 1/4
7 = G 1 1/2 or SAE 1 1/2"
- 10 filter housing specification:**
- = standard
IS06 = for HFC applications, see sheet-no. 31605
- 11 internal valve:**
- = without
S1 = with by-pass valve Δp 3,5 bar
S2 = with by-pass valve Δp 7,0 bar
R = reversing valve, Q 211,008 l/min
- 12 clogging indicator or clogging sensor:**
- = without
AOR = visual, see sheet-no. 1606
AOC = visual, see sheet-no. 1606
AE = visual-electric, see sheet-no. 1615
VS5 = electronic, see sheet-no. 1619

To add an indicator/sensor to your filter, use the corresponding indicator data sheet to find the indicator details and add them to the filter assembly model code.

1.2. Filter element: (ordering example)

01E. 170. 10VG. HR. E. P. -

| | | | | | | |
|---|---|---|---|---|---|---|
| 1 | 2 | 3 | 4 | 5 | 6 | 7 |
|---|---|---|---|---|---|---|

- 1 series:**
01E. = filter element according to company standard
- 2 nominal size:** 170, 240, 360, 450
- 3 - 7** see type index-complete filter

For more information:

WEB: FLTR.com.au PHONE: (+61) 1300 62 4020 EMAIL: info@FLTR.com.au SKYPE: Purple.Engineering



Technical data:

| | |
|--------------------------|--|
| operating temperature: | -10°C to +100°C |
| operating medium | mineral oil, other media on request |
| max. operating pressure: | 420 bar |
| test pressure: | 600 bar |
| process connection: | thread or SAE-flange 6000 PSI |
| housing material: | EN-GJS-400-18-LT, C-steel (filter bowl) |
| sealing material: | Nitrile (NBR) or Viton (FPM), other materials on request |
| installation position: | vertical |

Classified under the Pressure Equipment Directive 2014/68/EU for mineral oil (fluid group 2), Article 4, Para. 3.
Classified under ATEX Directive 2014/34/EU according to specific application (see questionnaire sheet-no. 34279-4).

Pressure drop flow curves:

Filter calculation/sizing

The pressure drop of the assembly at a given flow rate Q is the sum of the housing Δp and the element Δp and is calculated as follows:

$$\Delta p_{assembly} = \Delta p_{housing} + \Delta p_{element}$$

$$\Delta p_{housing} = (\text{see } \Delta p = f(Q) \text{ - characteristics})$$

$$\Delta p_{element} (mbar) = Q \left(\frac{l}{min} \right) \times \frac{MSK}{10} \left(\frac{mbar}{l/min} \right) \times v \left(\frac{mm^2}{s} \right) \times \frac{p}{0,876} \left(\frac{kg}{dm^3} \right)$$

For ease of calculation our Filter Selection tool is available online at www.eatonpowersource.com/calculators/filtration/


Material gradient coefficients (MSK) for filter elements

The material gradient coefficients in mbar/(l/min) apply to mineral oil (HLP) with a density of 0,876 kg/dm³ and a kinematic viscosity of 30 mm²/s (139 SUS). The pressure drop changes proportionally to the change in kinematic viscosity and density.

| HP3 | VG | | | | | G | | |
|-----|-------|-------|-------|-------|-------|--------|--------|--------|
| | 3VG | 6VG | 10VG | 16VG | 25VG | 25G | 40G | 80G |
| 170 | 2,187 | 1,518 | 0,972 | 0,846 | 0,578 | 0,0685 | 0,0640 | 0,0438 |
| 240 | 1,685 | 1,170 | 0,749 | 0,652 | 0,446 | 0,0531 | 0,0496 | 0,0340 |
| 360 | 1,233 | 0,856 | 0,548 | 0,477 | 0,326 | 0,0388 | 0,0362 | 0,0248 |
| 450 | 0,907 | 0,630 | 0,403 | 0,351 | 0,240 | 0,0285 | 0,0266 | 0,0182 |

$\Delta p = f(Q)$ – characteristics according to ISO 3968


The pressure drop characteristics apply to mineral oil (HLP) with a density of 0,876 kg/dm³. The pressure drop changes proportionally to the density.

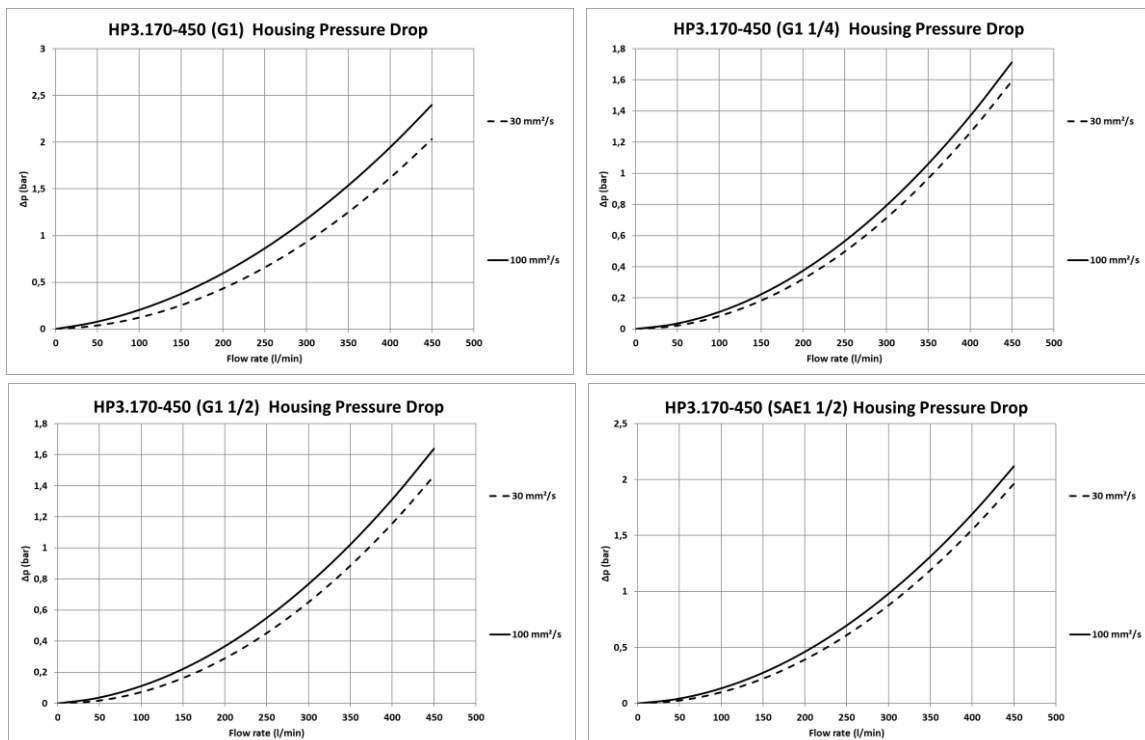

For more information:

WEB: FLTR.com.au PHONE: (+61) 1300 62 4020 EMAIL: info@FLTR.com.au SKYPE: Purple.Engineering

Symbols:

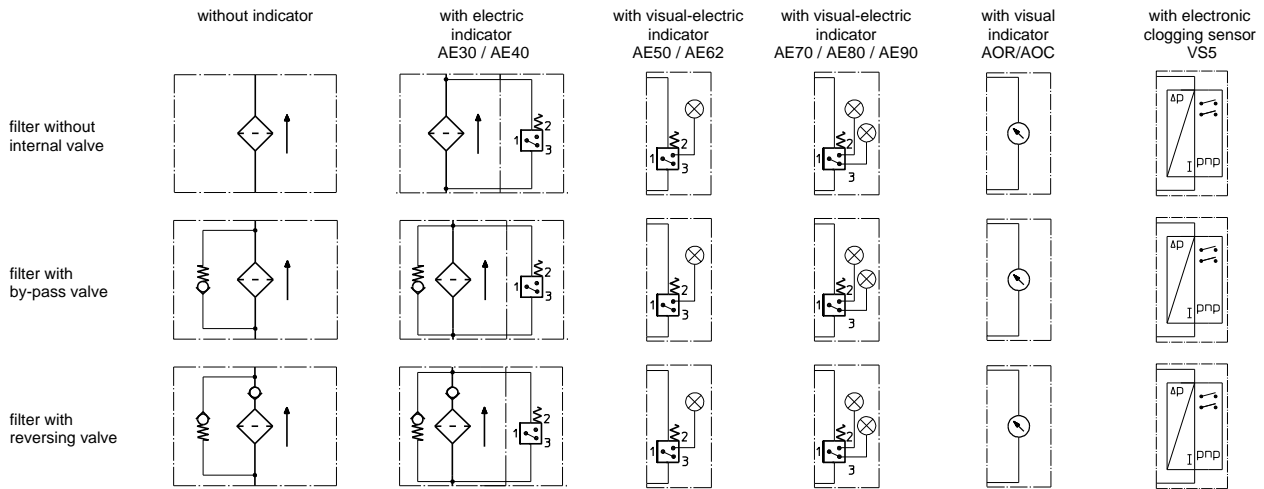

Spare parts:

| item | qty. | designation | dimension | | | | article-no. | |
|------|------|------------------------------------|--------------|------------|------------|------------|--------------------|--------------|
| | | | HP3.170 | HP3.240 | HP3.360 | HP3.450 | | |
| 1 | 1 | filter element | 01E.170... | 01E.240... | 01E.360... | 01E.450... | | |
| 2 | 1 | O-ring | 34 x 3,5 | | | | 304338 (NBR) | 304730 (FPM) |
| 3 | 1 | O-ring | 75 x 3 | | | | 302215 (NBR) | 304729 (FPM) |
| 4 | 1 | support ring | 81 x 2,6 x 1 | | | | 304581 | |
| 5 | 1 | clogging indicator visual | AOR or AOC | | | | see sheet-no. 1606 | |
| 6 | 1 | clogging indicator visual-electric | AE | | | | see sheet-no. 1615 | |
| 7 | 1 | clogging sensor electronic | VS5 | | | | see sheet-no. 1619 | |
| 8 | 1 | screw plug | 20913-4 | | | | 309817 | |

item 8 execution only without clogging indicator or clogging sensor

Test methods:

Filter elements are tested according to the following ISO standards:

| | |
|-----------|---|
| ISO 2941 | Verification of collapse/burst resistance |
| ISO 2942 | Verification of fabrication integrity |
| ISO 2943 | Verification of material compatibility with fluids |
| ISO 3723 | Method for end load test |
| ISO 3724 | Verification of flow fatigue characteristics |
| ISO 3968 | Evaluation of pressure drop versus flow characteristics |
| ISO 16889 | Multi-pass method for evaluating filtration performance |

For more information:

WEB: FLTR.com.au PHONE: (+61) 1300 62 4020 EMAIL: info@FLTR.com.au SKYPE: Purple.Engineering